

NOTES

1. MECHANICALLY PREPARE CONCRETE SURFACES IN ACCORDANCE WITH ICRI 03732 TO ACHIEVE A CONCRETE SURFACE PROFILE OF CSP-3 OR HIGHER, OR AS PER MANUFACTURER'S REQUIREMENTS.
2. MECHANICALLY PREPARE METAL SURFACES IN ACCORDANCE WITH SSPC-SP3 - POWER TOOL CLEANING, OR AS PER MANUFACTURER'S REQUIREMENTS.
3. INSTALL CANT BEAD OF POLYURETHANE SEALANT AT VERTICAL TRANSITION, AS PER SEALANT MANUFACTURER'S RECOMMENDATIONS. TOOL SEALANT AND SPRINKLE OVEN DRIED SAND IMMEDIATELY INTO SEALANT SURFACE WHILE TACKY. ALLOW TO CURE MINIMUM 24 HRS, OR AS REQUIRED.
4. INSTALL MIRACOTE MPC DECK COATING IN ACCORDANCE WITH SPECIFICATIONS AND MANUFACTURER'S INSTALLATION GUIDELINES.

Metal Pipe Surface Preparation - 


- Power tool clean to bright metal
- No primer required for MPC

Miracote MPC System - 

- Pedestrian Traffic - 2 Coat System (60 mils minimum)
- Vehicular Traffic - 3 Coat System (90 mils minimum)

Concrete Surface Preparation - 

- Concrete surface profile of CSP-3 or higher
- Saturated Surface Dry (SSD) substrate

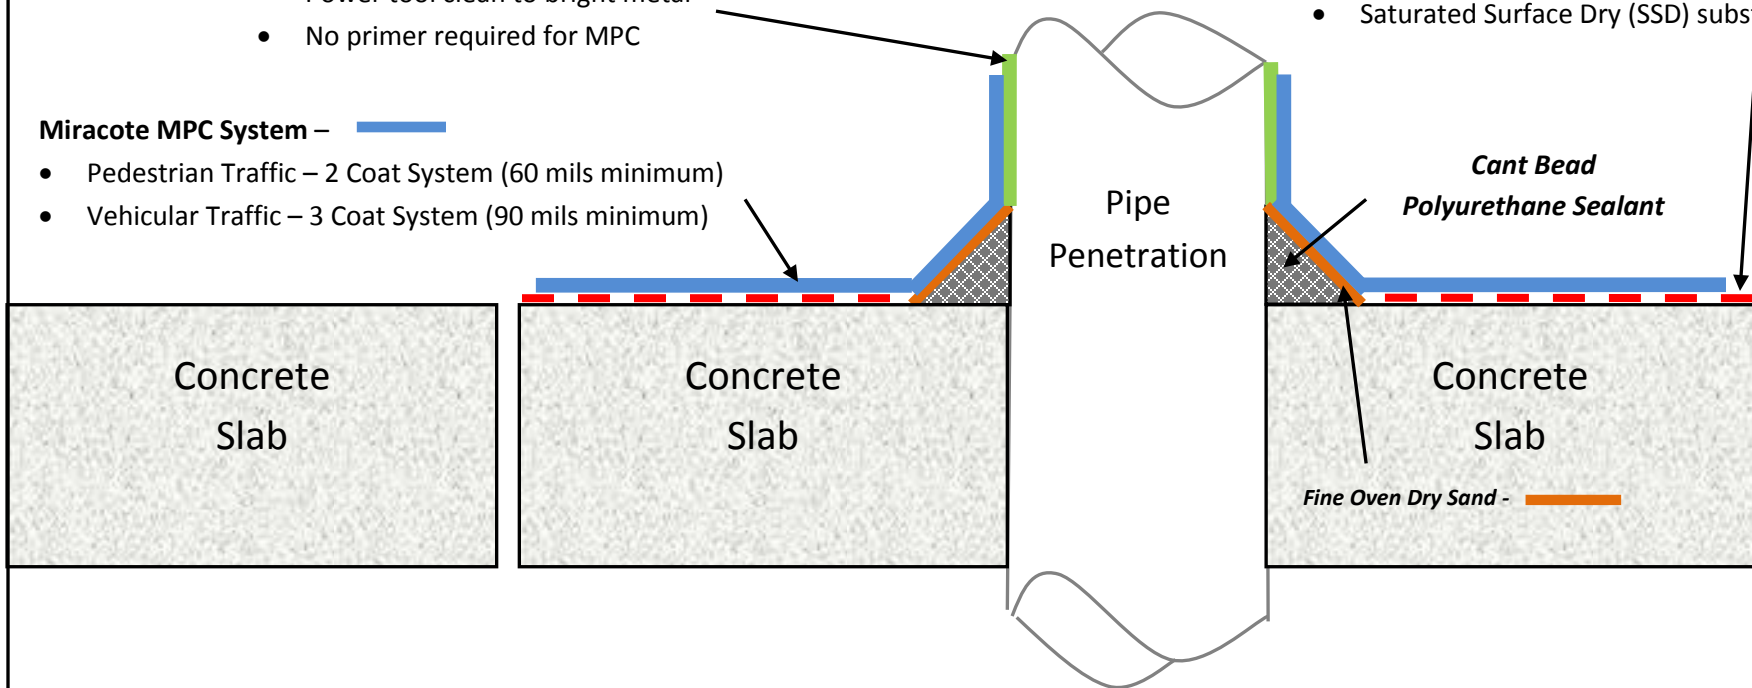

MIR.-MPC-PP1

05/18/2009

NTS

PIPE PENETRATION

Miracote MPC Deck Coating

