


**Notes:**

1. Mechanically prepare concrete surfaces in accordance with ICRI Guideline No. 310.2R-2013 to achieve a concrete surface profile of CSP-3 or higher, or in accordance with manufacturer's requirements.
2. Remove existing joint sealant and backing materials, and mechanically prepare joint wall substrates per the sealant manufacturer's recommendations.
3. Expansion joint must be a minimum of ¼" X ¼".
4. Install Miracote Miraflex Membrane C in accordance with specifications and the manufacturer's installation guidelines.
5. Sealant must be twice the width as the depth up to ½".
6. Tool flush and sprinkle oven dried sand immediately into sealant surface while wet.
7. Selected sealant must be rated for submersion.

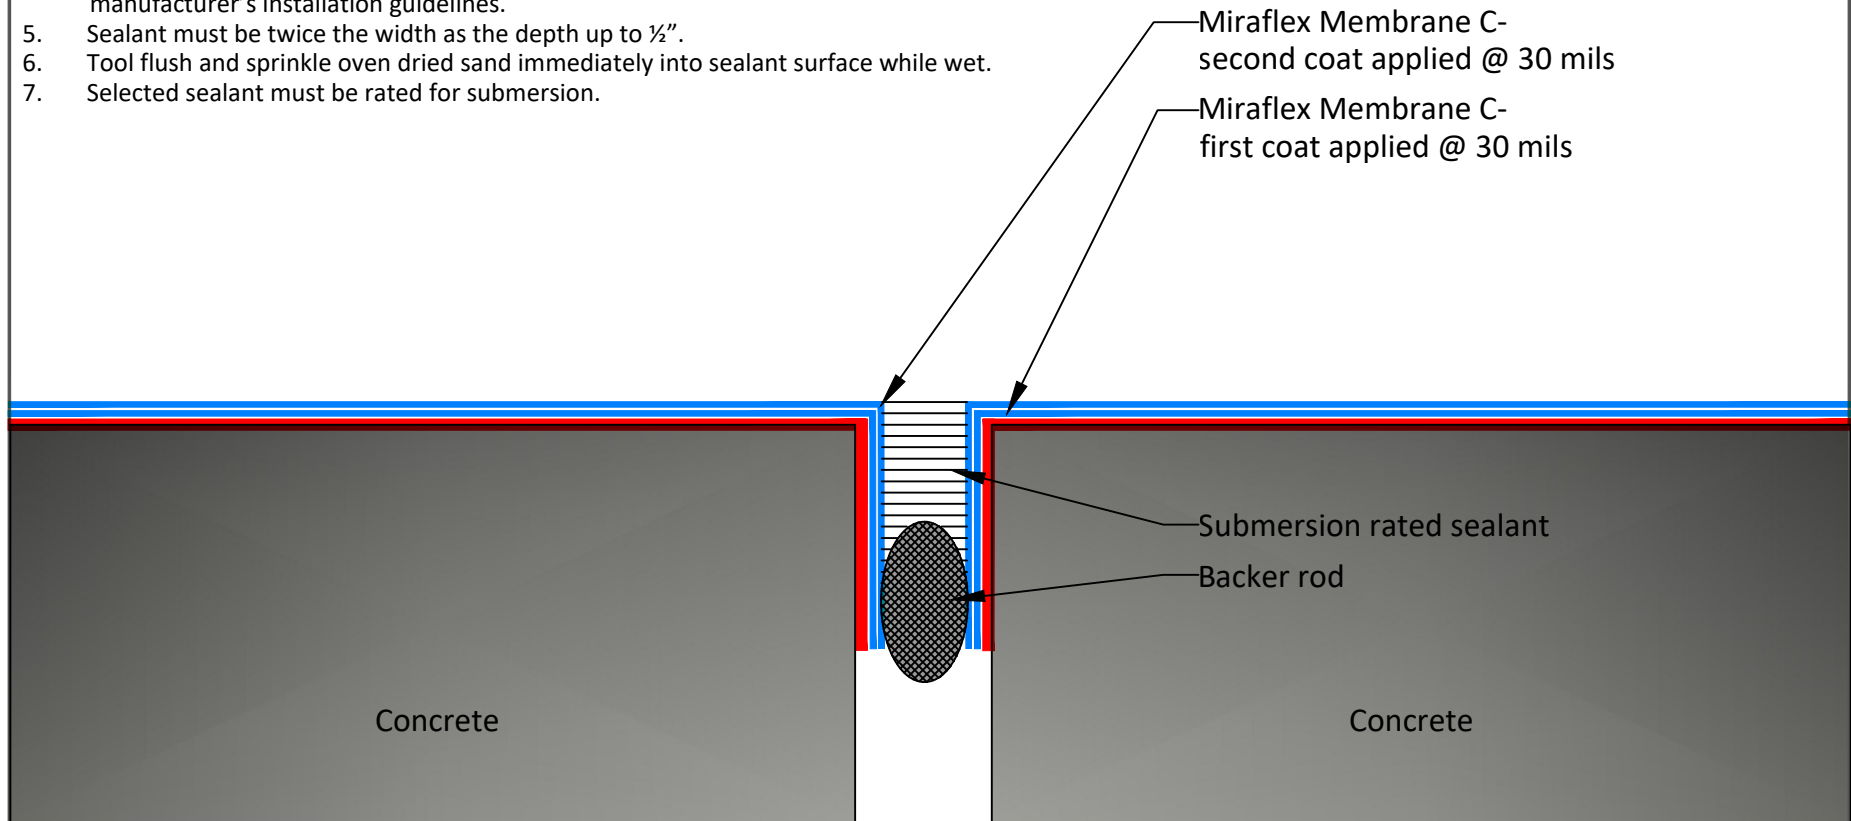

Miraflex Membrane C-  
second coat applied @ 30 mils

Miraflex Membrane C-  
first coat applied @ 30 mils

Submersion rated sealant

Backer rod

Concrete

Concrete

**Concrete surface preparation**

- Concrete surface preparation of CSP-3 or higher

**Miraflex Membrane C**

MIR-MEMC-EJ1

EXPANSION JOINT DETAIL  
Miraflex Membrane C



4/12/20

NTS